


Sprinkler System Backflow Assemblies and Installation Specifications

Reduced Pressure Zone Assembly

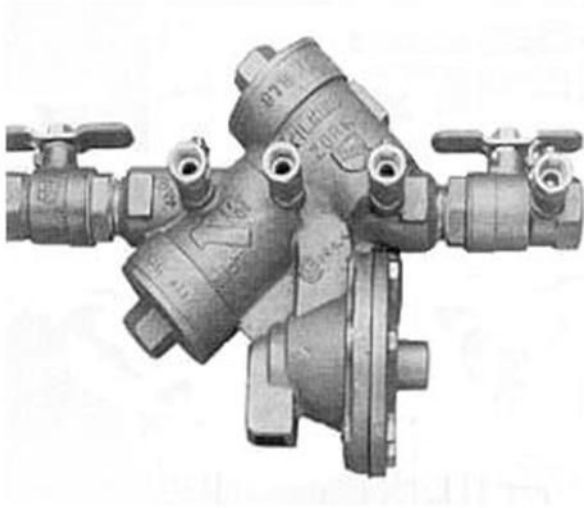

***Required on ALL Dual Sprinkler systems**

*Required on all culinary sprinkler systems from January 1, 2006. (A PVB is also acceptable but is **not** suitable for landscapes with **any** elevation changes. PVB's that are installed on such properties will be required to replace the assembly with an RP.)

*Cannot be installed in a Pit

*Must be installed 12" above finished grade

*Must be approved by the American Backflow Association

Double Check Assembly



**NOT APPROVED FOR NEW INSTALLATION
OR DUAL SYSTEMS!**

*Only approved if installed before January 1, 2006

*If unable to be repaired and pass a test it must be replaced by a Reduced Pressure Zone Assembly

*It may be located in a sprinkler box

*Must be approved by the American backflow Association